


REFER TO
CONSTRUCTION
DRAWINGS

REFER TO
CONSTRUCTION
DRAWINGS

VARIES

1500 (MIN)

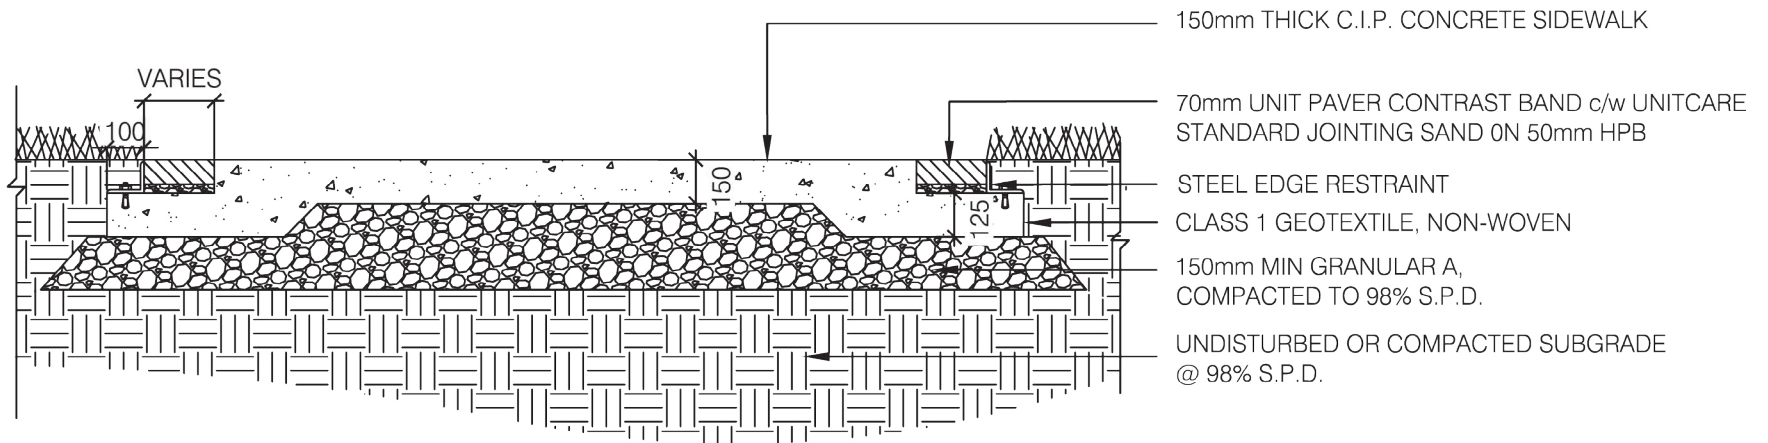

150mm THICK C.I.P. CONCRETE SIDEWALK

70mm UNIT PAVER CONTRAST BAND c/w UNITCARE
STANDARD JOINTING SAND ON 50mm HPB

STEEL EDGE RESTRAINT

CLASS 1 GEOTEXTILE, NON-WOVEN

150mm MIN GRANULAR A,
COMPACTED TO 98% S.P.D.

UNDISTURBED OR COMPACTED SUBGRADE
@ 98% S.P.D.

NOTES:

1. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED.
2. CONCRETE TO BE 32MPa AT 28 DAYS AND BE 5-7% AIR ENTRAINED.
3. CONTROL JOINTS TO BE LOCATED AT MAXIMUM INTERVALS OF 1.5m OC. CONTROL JOINTS TO BE SAW CUT TO A DEPTH OF 30mm.
4. EXPANSION JOINTS TO BE 12mm BITUMINOUS FIBRE BOARD SET AT 12mm BELOW GRADE AND FINISHED WITH CONCRETE COLOUR MATCHED POLYSULPHITE SEALANT FLUSH WITH FINISHED GRADE. LOCATE EXPANSION JOINTS EVERY THIRD JOINT AND WHERE CONCRETE MEETS OTHER HARD SURFACES AND STRUCTURES.



**Transportation
Services**

**CONCRETE SIDEWALK WITH INLAID
UNIT PAVER SOLIDER COURSE**

DATE: MARCH 2017

SCALE N.T.S.

REV.

X

X

SS-107